



FEATURES

- 7" LCD with resistive touch
- Built in Buzzer
- 10 password levels
- Modbus protocol
- Alarms
- Recipe Management
- Serial Printing
- Data Logging

SPECIFICATIONS

LCD MODULE	Display Type	7" TFT LCD (256 color), Resistive Touch Screen	
	Resolution	800 x 480 pixels	
	Display Size(WxH)mm	154.08 x 85.92	
	Backlight	LED backlight	
	Brightness Adjustment	Auto/Manual via system menu	
Keys		System key x 1, Function keys x 7	
MEMORY	Internal	Bitmap	4 MB
		Font	4 MB
		Application	512 KB
		Upload	2.5 MB
		System Reserved	5 MB
		Total	16 MB (System Memory)
	External	Micro SD upto 2 GB (User Memory)	
COMMUNICATION	Slave Port	RS232/485 (MODBUS RTU - Jumper Selectable)	
	Master Port	RS485 (MODBUS RTU)	
	Printer Port	RS232 (ESCPAUSE)	
	USB Slave	USB 2.0 (only for downloading)	
Operation Voltage		18 - 30VDC	
Real Time Clock (RTC)	Backup Battery	Replaceable 3V CR2032	
	Battery Life	10 year at 25°C	
	Accuracy	+/- 20 min per Year	
Buzzer	Type	Electro Magnetic Buzzer	
	Sound Output	85 dB at 10cm	
	Operation	Software Programmable	

Power Consumption	7W Max
Operating Temperature	0° to 55°C
Storage Temperature	-30° to 80°C
Humidity	95% RH
Certification	CE, UL (Pending)
Dimensions(WxHxD)mm	214 x 160 x 51.6
Panel Cutout(WxH)mm	196.9 x 142.9
Weight	730gms

SAFETY PRECAUTIONS

This manual is meant for personnel involved in wiring, installation, operation and routine maintenance of the equipment.

All safety related conditions, symbols and instructions that appear in this operating manual or on the equipment must be strictly followed to ensure operator and instrument safety. Any misuse may impair the protection provided by the equipment.

CAUTION : Read complete instructions prior to installation and operation of the unit.

INSTALLATION INSTRUCTIONS

CAUTION


1. This equipment, being built-in-type, normally becomes a part of the main control panel and the terminals do not remain accessible to the user after installation.
2. Conductors must not come in contact with the internal circuitry of the equipment else it may lead to a safety hazard that may endanger life or cause electrical shock to the operator.
3. Circuit breaker or mains switch must be installed between the power source and supply terminals to facilitate power 'ON' or 'OFF' function.
4. The equipment shall not be installed in environmental conditions other than those specified in this manual.
5. Since this equipment forms part of the main control panel, its output terminals get connected to the host equipment. Such equipment shall also comply to EMI / EMC and safety requirements like CE standard procedure.
6. Thermal dissipation of equipment is met through ventilation holes provided on housing of equipment. Obstruction of these ventilation holes may lead to a safety hazard.
7. The output terminals shall be loaded strictly as per the values / range specified by the manufacturer.

WIRING INSTRUCTIONS

CAUTION

1. Wiring shall be done strictly according to the terminal layout provided in the operating manual.
2. To eliminate electromagnetic interference use short wire with adequate ratings and twists of equal size.
3. The power supply connection cable must have a cross section of 1sq.mm or greater and insulation capacity of at least 1.5KV.

MECHANICAL INSTALLATION

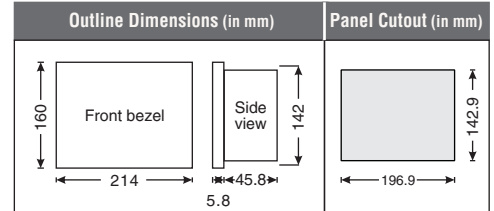

For installing the controller

1. Prepare the panel cutout with proper dimensions as shown above.
2. Remove the clamp from the SMI.
3. Fix the unit into the cutout. Insert the clamp from both sides and tighten the screws.

CAUTION

The equipment in its installed state must not come in close proximity to any heating sources, caustic vapors, oils, steam, or other unwanted process by products.


EMC Guidelines :

1. Use proper input power cables with shortest connections and twisted type.
2. Layout of connecting cables shall be away from any internal EMI source.

MAINTENANCE


1. To avoid blockage of ventilation holes, clean the equipment regularly using a soft cloth.
2. Do not use Isopropyl alcohol or any other organic Solvents for cleaning.

PANEL MOUNTING

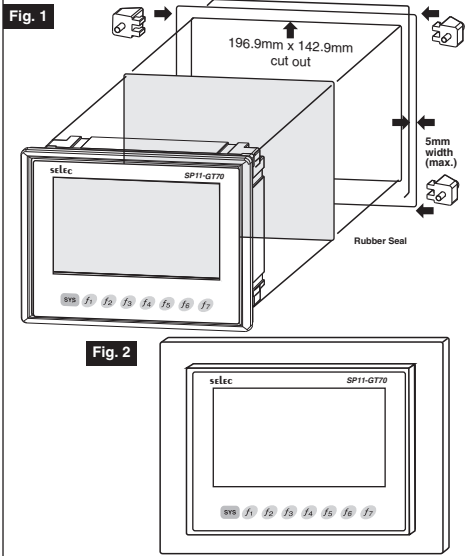


1. Before you begin, note that the mounting panel cannot be thicker than 5 mm (0.197").
2. Make a panel cut-out measuring 196.9mm x 142.9mm. (7.752" x 5.626")
3. Slide the controller into the cut-out, ensuring that the rubber seal is in place.
4. Push the 4 mounting brackets into their slots on the sides of the controller as shown in Fig. 1.
5. Tighten the bracket screws against the panel. Hold the bracket securely against the unit while tightening the screw.
6. When properly mounted, the controller is squarely situated in the panel cut out as shown in Fig. 2.

USER GUIDE

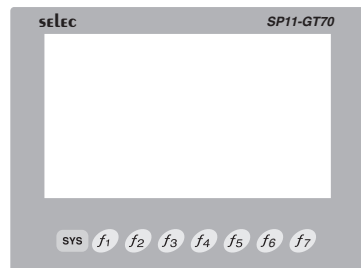

KEY	DESCRIPTION
SYS	Long press for 3 sec. to enter into internal menu for system info. Use for communications setting, backlight brightness control, touch calibration, to view memory usage and password setting.
f1	After firmware update use for enter into calibration mode in internal menu and Programmable key in Run mode. Also use for alarm acknowledgment.
f2 to f7	Programmable keys in Run mode.
f7	At power ON press to enter into firmware update mode.


UNDERSTANDING YOUR DEVICE

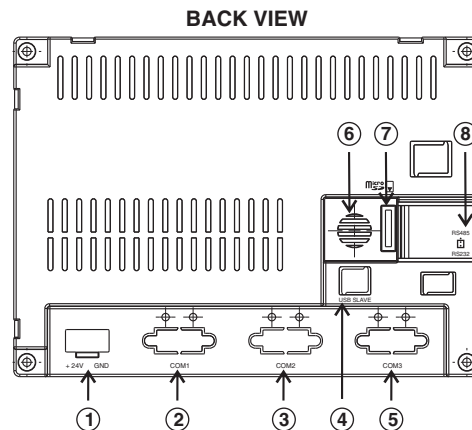

ITEM	DESCRIPTION
①	Supply Terminal
②	COM 1
③	COM 2
④	USB Slave Port
⑤	COM 3
⑥	Buzzer
⑦	Micro SD Card Slot
⑧	RS232/485 Slave Port selection

SLAVE PORT SELECTION

1. Open the battery cover.
2. RS232/485 slave can be selected by changing the jumper position as shown in the figure below.

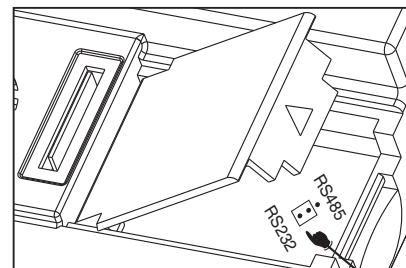

Change jumper position to switch between RS232 and RS485

PORT PIN CONFIGURATION

COM 1 MASTER PORT (Male Connector)	PIN	CONNECTION
	1	—
	2	—
	3	—
	4	—
	5	—
	6	—
	7	RS485 (+)
	8	RS485 (-)
	9	—
COM 2 SLAVE PORT (Female Connector)	PIN	CONNECTION
	1	—
	2	RS232 (TXD)
	3	RS232 (RXD)
	4	—
	5	GND
	6	RS485 (+)
	7	RS485 (-)
	8	—
	9	—
COM 3 PRINTER PORT (Male Connector)	PIN	CONNECTION
	1	—
	2	RS232 (TXD)
	3	RS232 (RXD)
	4	—
	5	GND
	6	—
	7	—
	8	—
	9	—


USB SLAVE

Connection	USB Slave port can be connected with a PC
Port Function	The port is only used to download user program to the HMI

MEMORY INSTALLATION

• Installing micro SD Card

- Push the micro SD Card into the slot until it clicks.
- See Below figure for mounting direction.

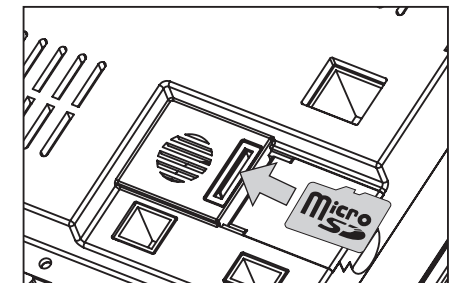

• Removing micro SD Card

- Push on the micro SD Card until it clicks and is released.

ORDERING INFORMATION

ORDER CODE SP11-GT70

ACCESSORIES

Window-Based Software for SMI

AC-USB-RS232-01 (For downloading from USB Port)

ACH-001 (For downloading from Serial Port)

ACH-002 (For Master Port)

AC-IO EXP-02 (For Master to slave communication)

PS-CF-24V-1.1A

? SERVICE DETAILS

This device contains no user serviceable parts and requires special equipment and specialized engineers for repair. Please contact service center for repair on the following numbers:

Toll free : 1800 227353 (BSNL/MTNL subscribers only)
Others : 91-22-40394200/40394202

NO WARRANTY ON UNIT DAMAGED DUE TO WRONG POWER SUPPLY.

(Specifications subject to change as development is a continuous process.)

Selec Controls Pvt. Ltd., India

Factory Address :
EL-27/1, Electronic Zone, TTC Industrial Area,
MIDC, Mahape, Navi Mumbai - 400 710, INDIA.
Tel. No. : +91-22-28476443 / 1882
Fax No. : +91-22-28471733 | Toll free : 1800 227 353
Website: www.selec.com | Email: sales@selec.com